

A Novel Cable Identification Method based on PLC

Jong Jung Woo and Su Goog Shon

¹*School of Information Technology, Sungshin Woman's University, 249-1
Dongsen-dong 3-ga, Seongbuk-gu, Seoul, 136-742, Korea*

²*Department of IT Engineering, The University of Suwon, IT Building, san 2-2
Wau-ri, Bongdam-eup, Hwaseong-si, Korea*

¹*jwoo@sungshin.ac.kr, sshon@suwon.ac.kr (corresponding author)*

Abstract

In addition to phase identification, cable identification is also a challenging issue. Power-line communication technology is applied to identify cables of power distribution systems. Power cable circuits have only a limited ability to carry higher frequencies. Typically transformers prevent propagating the higher frequency carrier signal. The proposed method uses the limited propagation ability to identify the cable. A new cable identification system is designed and implemented. The system consists of a transmitter and a receiver with power-line communication module. Some experiments are conducted to verify the theoretical concepts. Also some simulations are done to help and understand the concepts by using Simulink simulator. It can extend the application area of power-line communication.

Keywords: *Simulink, Cable Identification, Power-line communication, Distribution lines control communication*

1. Introduction

Electrician on site should correctly figure out electrical configurations such as phases and cable connections. The unmistakable identification of cables and phases is an absolute safety related task. A wrong selection can result in fatal consequences for the operator and caused the loss of supply for the connected customers. Especially, low voltage connectivity data (relation from MV/LV transformer with end user) results critical for the correct management electrical distribution networks.

The need is increasing for determining phases and cables in the 3-phase 4-line type distribution lines with multiple grounds. The determination of an absolute phase and cable is difficult when it is needed. When confusion in lines for phases and cables occurs, disproportionate concentrations of loads can easily occur, and this type of disproportionate concentration of loads can cause phase unbalance that can lead to power loss or power failure and, further, equipment failure due to excessive voltage regulation or reduction of useful life, *etc.* What this would all mean is that it can result in substantial management difficulties such as economic losses, all because of the reduced quality of voltage supplied to the customer. Thus, engineers must become able to figure out there in the field as to which phase of A, B and C phases the line conductors belong and as to which transformer the line conductors is connected.

Distribution lines branch into multiple circuits to power local pole- or pad-mounted transformers [1]. Usually in a substation, the A, B, C phase values for electrical signals are made known, however, as one approaches toward the end of the distribution lines, the effort to distinguish both an absolute phase value and cable configurations to transformer becomes more difficult. As such, most of phase distinguishing methods employ methods that distinguish phases based on comparing the known phase value of a substation with the unknown phase value of a local site [2-6].

In addition to the phase identification, the cable identification is also a challenging issue. Consider the situation that many transformers and distribution lines are deployed along the street as shown in Figure 1. There, an electric technician wants to find out transformer or distribution line to which premise power line cables are connected. It is not easy to figure out because there are too many obstacles such as buildings, trees, hills.

In the first, some explanations need about the way to identify the cable at local site. The recent cable identification system, newly developed, consists of current impulse generator and receiver. The receiver is connected by a clamp for decoupling the identification signal. The pulse generator generates some special type of pulses and transmits them into the cables being identified [7]. The sent impulse signal causes an electromagnetic field with a defined polarity around the cable which is received with the flex coupler of the receiver, automatically synchronized. The directional clamp in combination with the parameter monitoring by the receiver provides a safe selection regardless of any interference. It means that only one conductor or cable has the correct polarity while all other cables have the opposite polarity. As another method, direct signals are injected on the transmitter and the received signals are analyzed in terms of amplitude-time-phase at receiver [8]. Another method is to communicate coded messages between central device and line device through the distribution networks [9].

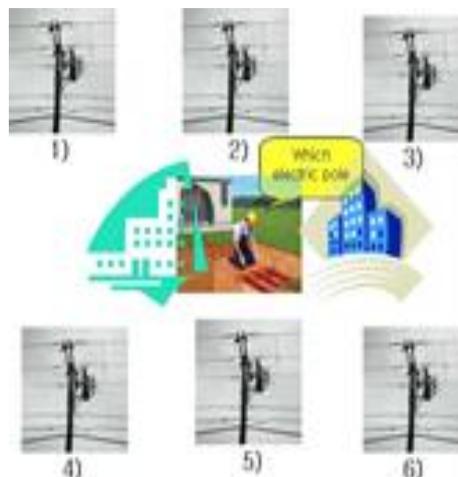


Figure 1. Situation to Require Cable Identification

In this paper, we propose how to find out the cable identification by using power-line communication for the easy, reliable and safe selection of cables. The paper uses that power cable circuits have only a limited ability to carry higher frequencies because transformers prevent propagating the carrier signal. A new cable identification system is designed and implemented. The system consists of a transmitter and a receiver with power-line communication module. Some experiments are conducted to verify the theoretical concepts. Also some simulations are done to help and understand the proposed system by using Simulink simulator.

2. Proposal of Novel Cable Identification Algorithm

Electrical power lines are usually classified into high, medium and low voltage lines. High voltage lines form the transmission network that transports energy at over 100kV from generating power plants to electrical substations located near demand centers. Medium voltage lines (typically below 50kV) and low voltage lines (less than 1kV) form the distribution network, which carries electricity from the transmission system and delivers it to consumers. Various wiring topologies exist and differ from country to country, and also within each country, for example radial and interconnected distribution

networks, delta and wye three-phase services, single-phase and split-phase low-voltage services, different earthing systems.

The power grid can be considered as communication channel based on power line communication technology. A wide range of power-line communication technologies are needed for different applications, ranging from home automation to internet access which is often broadband over power lines (BPL). Power line communications have been used at all levels of the power grid; on high voltage lines for telemetry, protection and control by utility companies; on medium voltage for advanced metering and grid optimization by electricity providers, but also for high-speed Internet distribution; finally, the vast majority of PLC applications are on low voltage lines, both indoor and outdoor (between transformers and buildings), for both low-speed command and control applications and high-speed networking. Recently, advanced metering infrastructure (AMI) systems are widely used.

In spite of the growing use of digital communication systems, PLC is still often the most cost effective and reliable solution to cover the operational needs of a power system. The key advantage of PLC is the use of existing electrical lines as communication medium, which provides the major benefit of eliminating considerable costs of installing networking infrastructure, like dedicated cables or antennas. Data is sent on the power lines by superposing a modulated high-frequency carrier signal on the line voltage, being high, medium or low, AC or DC. The carrier signal is then de-coupled and demodulated at the receiving end to recover the information.

We distinguish today between two classes of PLC systems: narrowband and broadband. Usually, narrowband PLC (NB-PLC) refers to low bandwidth communication, utilizing the frequency band below 500 kHz and providing data rates of tens of kpbs. Broadband PLC (BPL) utilizes a much wider frequency band, typically between 2MHz and 30MHz, and allows for data rates of hundreds of Mbps.

The power lines were not designed for data transmission and they constitute a challenging environment for communication. The transmission grid and even more the distribution grid have the characteristics of a very complicated wired network, which vary with time, location and are frequency-dependent. The main factors that affect the communication performance are high signal attenuation and considerable noise. Also, severe electromagnetic compatibility restrictions impose non-negligible challenges to PLC systems. Those are the reasons why most PLC technologies limit themselves to one type of wires (such as premises wiring within a single building). These characteristics can inversely be utilized to identify cables

Typically transformers prevent propagating the signal, which requires multiple technologies to form very large networks. Various data rates and frequencies are used in different situations. Power distribution transformers cause high signal attenuation when PLC devices are located on primary and secondary sides, for example in communication between meters on the low voltage line and a concentrator connected on medium voltage side. Signal propagation on multiple paths and signal reflection due to impedance mismatches in branching points can generate attenuation distortion of PLC signals. This phenomenon is less observed at low communication frequencies (below 150 kHz), since the signal wavelength is quite long (over 1km).

Whatever the type of modulation used, a PLC transceiver includes a few basic blocks as shown in Figure 2. Different solutions use various levels of integration of these components, from full-digital modems with external discrete components to highly integrated systems-on-chip [10].

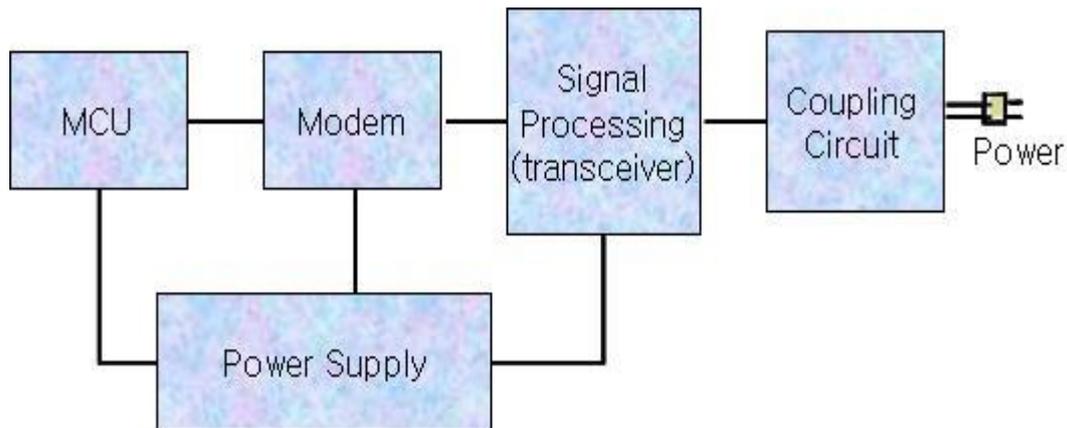


Figure 2. Architecture of PLC Transceiver [10]

The core of each transceiver is the modem itself, which usually implements the Physical and Data Link layers, according to the OSI model. Modulation-demodulation, error correction, media access control are among the major functions performed at this level. A processing unit is responsible for networking, protocol, and application-specific functions. At the other side, transmitted and received signals are processed, in digital and analog form; the main operations include filtering and amplification.

Figure 3 proposes how to identify a particular transformer among three transformers. The system consists of client and server. Carrier signals are transferred between client and server via power-line communication. Power-line communications systems operate by adding a modulated carrier signal to the wiring system. Since the power distribution system was originally intended for transmission of ac power at typical frequencies of 50 or 60 Hz, power cables have only a limited ability to carry higher frequencies. The propagation problem shall be a limiting factor for each type of power-line communications. Especially, the transformer would block the carrier signal cross over the transformer. We expect the modulated carrier signal by the client would not cross over the transformer Tr.2. Even though the signal can cross over the transformer Tr.2, its size would be weak enough not to be communicated via PLC modem.

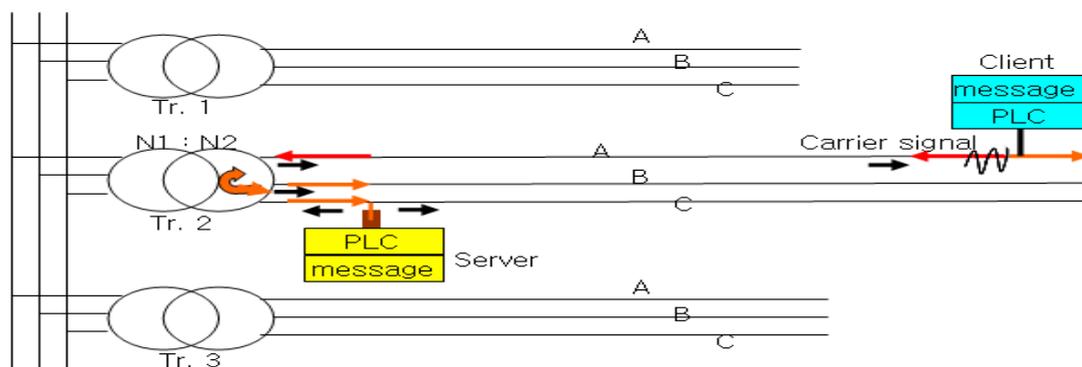


Figure 3. Operation to Identify Transformer

If the above characteristics becomes true, novel cable identification methodology can be developed. The injected signal would not be detected from other distribution lines connected with Tr.1 or Tr.3. The server unit on distribution lines linked with Tr.2 would respond with the corresponding signal. Also, the responded signal would be received by the client. Then, we would say that the client and the server be connected to the same cable and transformer.

Figure 4 shows how to figure out cable identification by using more servers with different coded messages. As one client sends out a request message, all the server would respond with different code messages. The client would receive sequentially message at different time depending on the distance between the client and servers.

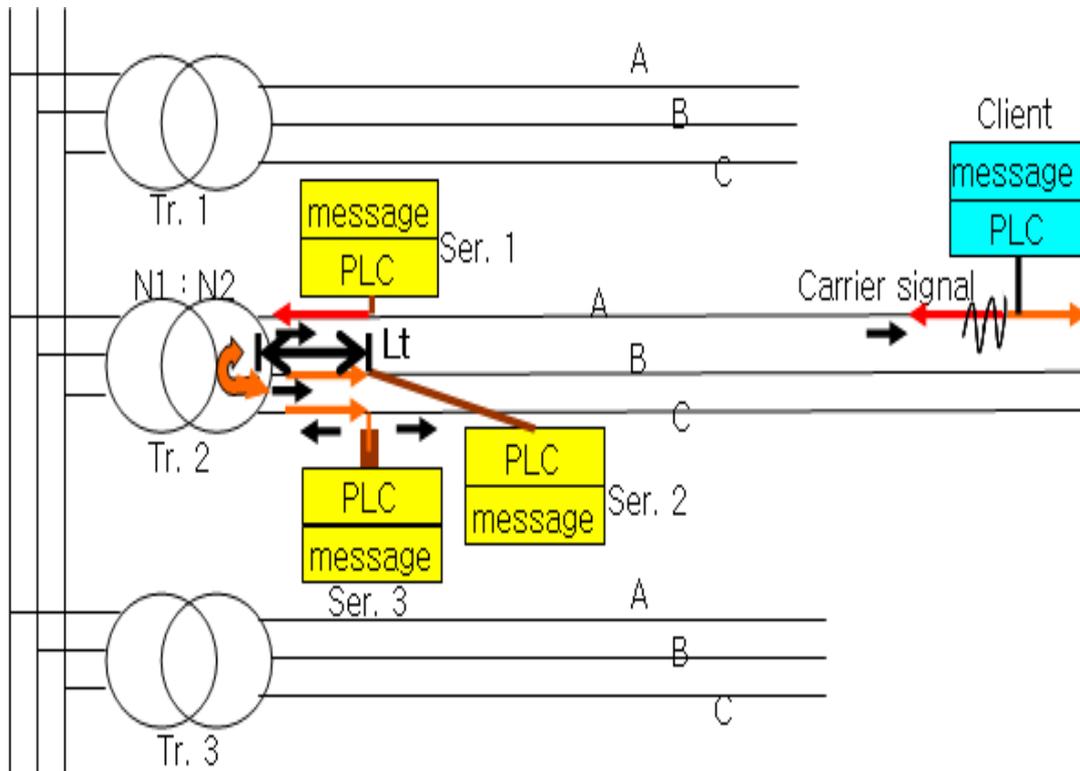


Figure 4. Operation to Identify Cables

The distance between the transformer Tr.2 and a server is 'Lt'. Also, the distances between the transformer Tr.2 and other servers are 'Lt's. Consider that the client starts send message at 'to' and receive messages from the nearest server 1 at time 't1'. The client may receive later other message from other servers (ser. 2 and ser. 3) at time 't2' ('t3') as shown in Figure Geographically, other servers (ser. 2 and ser. 3) are located far way two times of 'Lt'.

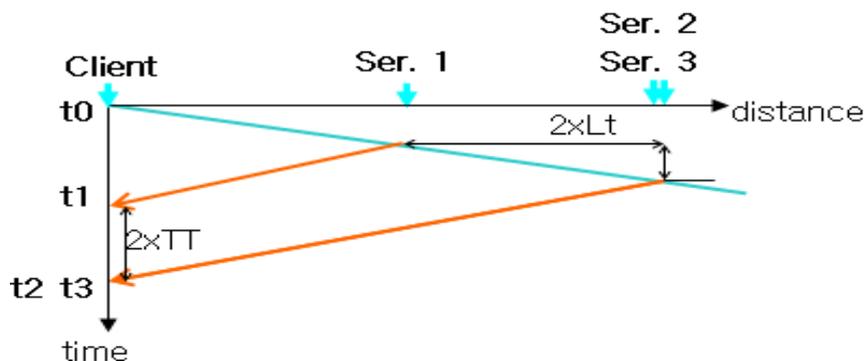


Figure 5. Flow of Operation between the Client and the Servers

The transmission time that the carrier signal transmits over the distance 'Lt' becomes 'TT' = Lt/S, where S is the propagation speed of carrier signal. Finally, the client would receive different code messages at different times, 't1', 't2' (= t1 + 2 x TT), 't3' (= t1 + 3 x TT), respectively. If the client could discriminate the messages received different times ('t1', 't2', or 't3'), cable identification can be possible.

As an example, Lt = 100 m, S = 3 x 10⁸ m/s. Then the round delay time RDT (= 2 x TT) becomes around 700 microseconds.

For the determination of cable identification, special algorithm for the server and client is required. The client and the server need to communicate coded messages each other and resolve the messages. Error detection algorithm is also required for reliable identification. The client and server would be implemented with embedded system.

Figure 6 shows the flow chart for algorithm to determine the nearest server. It is required that both the client and servers are ready. The server only responds whenever there is client request. The client starts to send request message. A server may respond corresponding message with server identification number. After analyzing received the message, the client can determine the nearest server which may be directly connected to the client. The nearest server would respond on the client request in the first if possible discriminates RDT precisely.

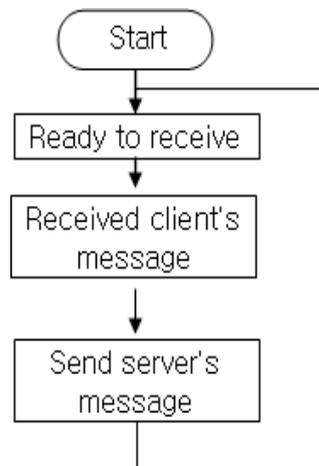


Figure 6. Flow Chart for Determination of Nearest Server

3. Simulink Model for 3-Phase Distribution Lines

In order to apply properly the cable identification technology, some analyses about power-line communication should be required for distribution lines. It is important to determine the frequencies of power-line communication between broadband PLC(BPLC) and the narrowband PLC(NB-PLC).

Traditionally, a 3-phase line was described as a single phase, lumped model by using equal load and balance line conditions, and the analysis that calculates the phase shifts was performed based on the Kirchhoff's voltage law [6].

Distribution network is comprised of 3-phase power sources, circuit breakers, distribution lines, transformers, loads, ground, etc. Distribution network, in particular, can be described with branches going out in radial direction from a substation.

A model that can analyze the carrier signal between the two points on a distribution line is designed. Figure 7 shows a simplified model of distribution lines that have 3-phase, 4-wire multiple conductors with a multi-grounded neutral.

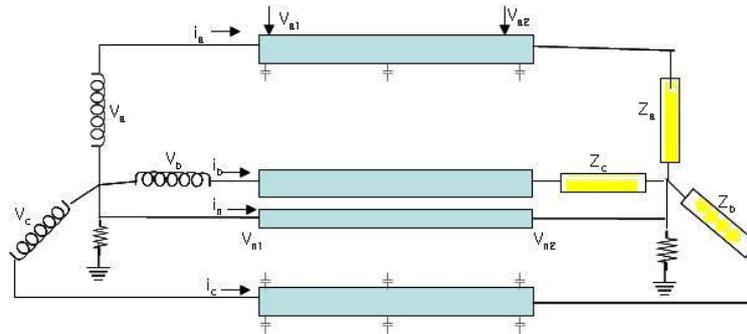


Figure 7. 3-Phase 4-Wire Grounded wye Line Segment Model

The distribution lines can be modeled as a distributed parameter circuit through the application of, instead of a static model based on the circuit theory of Kirchhoff, the transmitted wave theory. Power signal that goes through a power line moves in accordance with the electromagnetic transmission theory. The power waveform applied to the lines is assumed to be a sinusoidal waveform. The individual phase of a three-phase voltage signal is a 120° apart and it is of a 60Hz frequency. In order to distinguish individual 3 phases, the symbols *A*, *B* and *C* are used. The transmission equation for a power signal is applied to a distribution line.

Applying Kirchhoff's voltage law to the 4-wire grounded neutral line circuit, phase impedance matrix is obtained by Equation (1).

$$\begin{bmatrix} V_a \\ V_b \\ V_c \\ V_n \end{bmatrix} = \begin{bmatrix} V_a \\ V_b \\ V_c \\ V_n \end{bmatrix} + \begin{bmatrix} Z'_{aa} & Z'_{ab} & Z'_{ac} & Z'_{an} \\ Z'_{ba} & Z'_{bb} & Z'_{bc} & Z'_{bn} \\ Z'_{ca} & Z'_{cb} & Z'_{cc} & Z'_{cn} \\ Z'_{na} & Z'_{nb} & Z'_{nc} & Z'_{nn} \end{bmatrix} \begin{bmatrix} I_a \\ I_b \\ I_c \\ I_n \end{bmatrix} \quad (1)$$

Equation (1) can be reduced 3 x 3 phase matrix consisting of the self and mutual equivalent impedances for the three phases. "Kron" reduction method is applied in usual. Finally, Equation (2) for converting line-to-ground phase voltages to sequence voltages is obtained by:

$$\begin{bmatrix} V_0 \\ V_1 \\ V_2 \end{bmatrix} = \begin{bmatrix} V_0 \\ V_1 \\ V_2 \end{bmatrix} + \begin{bmatrix} Z_{00} & Z_{01} & Z_{02} \\ Z_{10} & Z_{11} & Z_{12} \\ Z_{20} & Z_{21} & Z_{22} \end{bmatrix} \begin{bmatrix} I_0 \\ I_1 \\ I_2 \end{bmatrix} \quad (2)$$

, where the diagonal terms of the matrix are the sequence impedances of the line such that:

- Z_{00} = zero sequence impedance
- Z_{11} = positive sequence impedance
- Z_{22} = negative sequence impedance

As an example, the Simulink model including several transformers and distribution lines is shown in Figure 8.

More details for the Simulink model such as power sources, lines, unbalanced loads, transformers, grounding resistor and phase measurement system for phase simulation are explained below. In the first, the input source is expressed in terms of power with an internal resistance and inductance. Power capacity that can sufficiently provide power used in the load is arranged. Power is wired as a 3-phase and a supply voltage is sinusoidal. A neutral point is connected to a grounding resistance. The power output is provided to distribution lines through a transformer wired as a wye(*Y*) or delta (*Δ*).

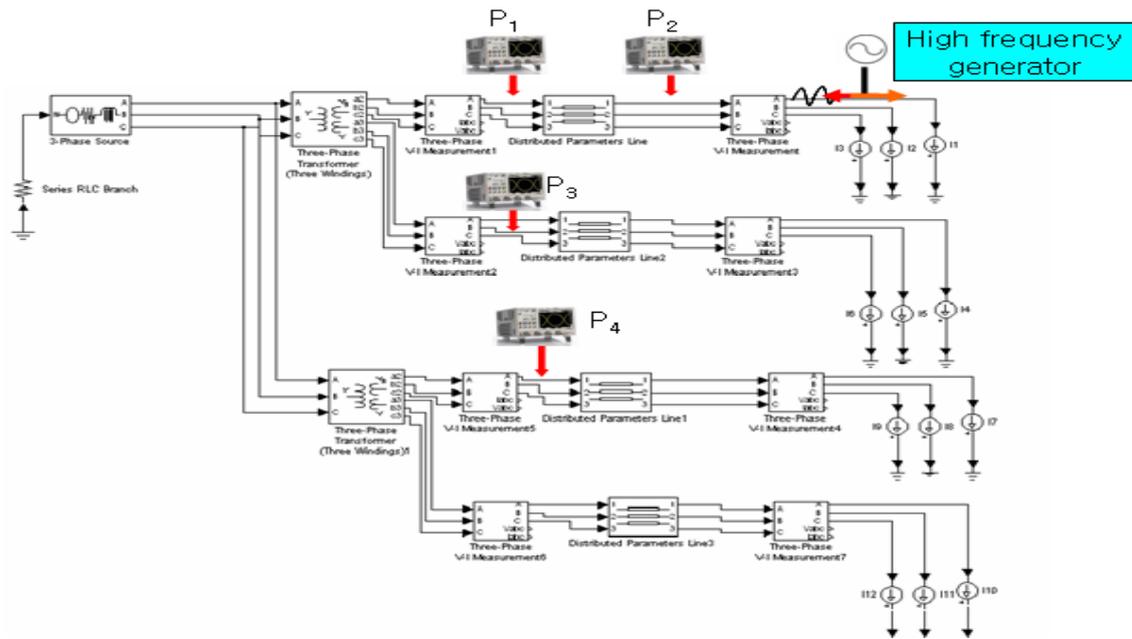


Figure 8. Sample of Simulink Distribution System Model

For the Simulink model of loads, various forms such as constant impedance, a constant current load, or a constant capacity, etc. can be used. A constant impedance model is that linear load that has a series resistance, inductance and capacitance value in a prescribed frequency. The effective and reactive power dissipated in the load has the characteristics of being proportional to square of the applied voltage. Simulink model of a constant current load is useful for allotting any current by lines and is used in this paper.

In modeling a transformer, the voltage ratio of primary and secondary voltages and wiring method can set. Transformer specifications used in simulation comprise 3-phase transformer with 3 single-phase transformers, and *Y* and *Delta* wiring is possible in the primary and secondary. In this paper, the transformer model that takes into consideration internal loss that is dependent on internal resistance and inductance is used. Recent transformers have very low resistance and voltage drop. Therefore, usually the voltage phase shift across a transformer is calculated as less than $\pm 5^\circ$.

Ground is modeled as having only a resistive component. Ground resistance is assumed to be 5Ω , which is a standard value for a 22.9 kV multiple-grounding system [11].

For the distribution lines, parameters are represented as symmetric (zero, positive, negative) components [9, 12, 13].

4. Simulation and Implementation Results

Figure 9 shows architecture of cable identification systems, which is comprised of a server and a client. Message from client program is transferred into PLC modem through interface. PLC modem converts the message into signal, which is modulated into higher carrier frequency. The modulated signal is transferred into the server. The server side's PLC modem receives the modulated signal and demodulates that into data. Then it is moved into the microprocessor. The server program responds to the client.

The power needs to activate the microprocessor and system. The power source unit is for the power. Here the carrier frequencies are 290 KHz and 125 KHz with narrow band modulation of simple MAC.

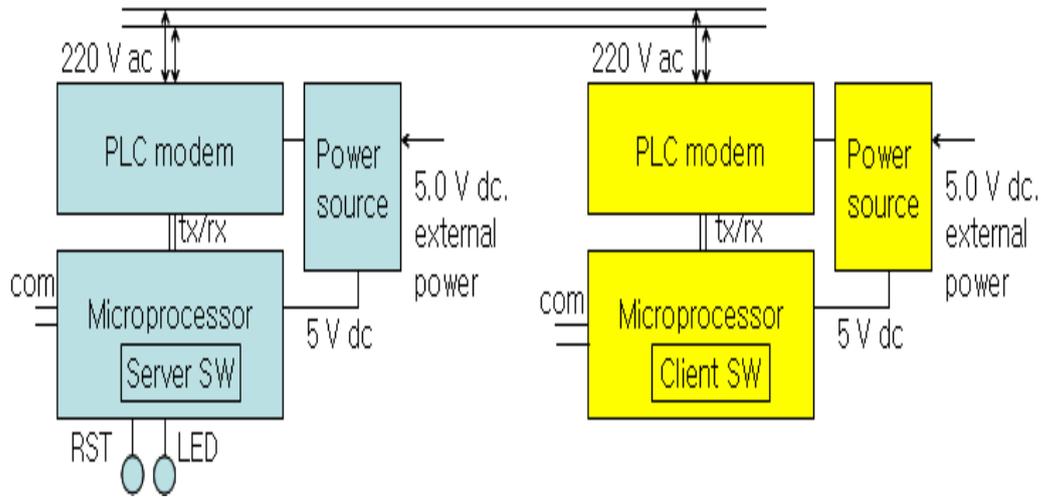


Figure 9. Architecture of Cable Identification Systems

It is to determine the frequencies of power-line communication. Many nations regulate unshielded wired emissions as they have the potential to cause radio transmissions. It is recommended that unlicensed bands or below 500 kHz be used.

Using the sample distribution model shown in Figure 8, the distribution system is analyzed with Simulink when carrier signal of 290 kHz and 300 mA is injected onto the distribution lines.

With the assumption that electrical signals move at the speed of light is made, propagation time would be required for electrical signals to move a certain distance. There are several factors such as propagation delay, the length of line, the distributed parameters, and load current, *etc.*, to affect the modulation characteristics. The length of 'Lt' is used 500m.

The component values used in the simulation of equation (2) are as follows [14].

Zero Phase $R_0 = 0.23 \Omega/\text{km}$, $L_0 = 5.478 \text{ mH}/\text{km}$, $C_0 = 0.008 \mu\text{F}/\text{km}$ Positive Phase $R_1 = 0.17 \Omega/\text{km}$, $L_1 = 1.21 \text{ mH}/\text{km}$, $C_1 = 0.00969 \mu\text{F}/\text{km}$

Figure 10 and Figure 11 show voltage waveform for three different positions (P2, P3, and P4). In order to show the characteristics of modulated signal, some larger, exaggerated, carrier signal of 300 mA is used to. Figures show that modulated signal is gone away at P4 which is located on the other transformer.

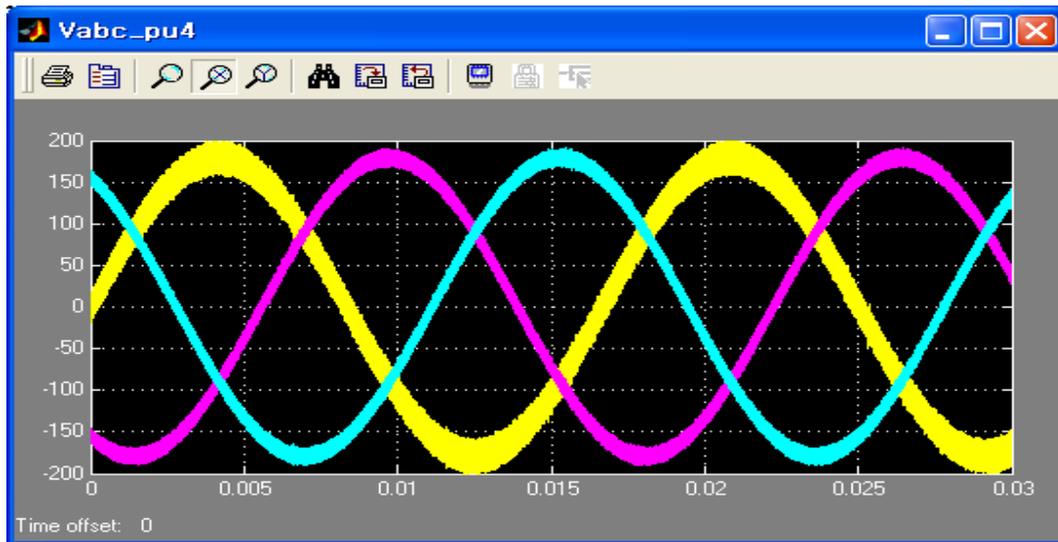


Figure 10. The Secondary-Side Low Voltage Waveform at P3 for Carrier Signal of 290 kHz and 300mA



Figure 11. The Secondary-Side Low Voltage Waveform at P4 of the Other Transformer Cross One Transformer for Carrier Signal of 290 kHz and 300 mA

A test system is implemented. The PLC modem chip with carrier frequency of 290 kHz/125 kHz and narrowband simple MAC is used. Arduino Uno board is used for microprocessor unit [15].

Experiments show that the PLC carrier signal is transferred into the range of PLC carrier propagation.

5. Conclusions

For the proper application of the cable identification technology, characteristics of higher frequency carrier propagation are analyzed through several transformers with Simulink. Simulink models and theoretical methods are presented for the analyses. Theoretical simulation results in that the injected carrier signal is hard to cross over the higher level transformer.

In order to verify the idea, the proposed cable identification system is implemented with narrowband power-line communication module with simple MAC and 290 kHz and 125

kHz. Experiments show also that the carrier signal is not transferred over the higher level transformer.

For the further research topics, more experiments are considered.

Acknowledgements

This study was conducted by [GRRC (Gyeonggi Regional Research Center) Suwon 2015-B4, Development of smart emergency response and application systems] as part of projects of GRRC, Gyeonggi Province. The advice received from S. J. Choi of Editech, Ltd. is highly appreciated.

References

- [1] C. D. Scott and R. E. Smalley, J. Nanosci. Nanotechnol, vol.3, no.75, (2003). J. McDonald, "Electric Power Substations Engineering", 2nd, CRC Press, (2007).
- [2] Bouvrette and Michel, "Telephasing method and system for remotely identifying unknown phases of transmission or distribution lines within an electrical network", (1986).
- [3] Pomatto and A. Lawrence, "Apparatus and method for identifying the phase of a three phase power line at a remote location", (1996).
- [4] K.E. Martin, "IEEE Standard for Synchrophasers for Power Systems", IEEE Transactions on Power Delivery, vol.13, no.1, (1998), pp.73-77.
- [5] G. H. Piesinger, "Apparatus and method for identifying cable phase in a three-phase power distribution network", (2006).
- [6] W. H. Kersting; "Distribution System Modeling and Analysis"; CRC Press, (2002).
- [7] <http://www.sebakmt.com/products/cable-identifier.html>
- [8] www.powerpoint-engineering.com BAUR KSG 100 cable identifier
- [9] F. L. Bertotti, M. S. Hara and P. J. Abatti, "A simple method to measure phase difference between sinusoidal signals", Rev. Sci. Instrum. 81, 115106, (2010), doi: 10.1063/1.3498897 (4pages)
- [10] C. Ferreira, L. Lampe, J. Newbury and T.G. Swart, "Power Line Communications: Theory and Applications for Narrowband and Broadband Communications over Power Lines", John Wiley & Sons, (2010).
- [11] IEEE Recommended Practice for Grounding of Industrial and Commercial Power Systems, (1992).
- [12] J. R. Carson, "Wave propagation in overhead wires with ground return", Bell System Technical Journal, vol.5, (1926).
- [13] G. Kron, "Tensorial analysis of integrated transmission systems", AIEE Transactions, vol.71, (1952).
- [14] W. G. Zhang, "Application of Wavelet Packet Analysis in Phase-to-Ground Fault Detection of Distribution Power System", The International Conference on Electrical Engineering, (2009).
- [15] H. J. Byun, C. Feng and S. Shon, "Implementation of a WLAN DMX Server based on NDIS WLAN Miniport Driver", International Journal of Smart Home, vol.7, no.4, (2013), pp.361.

Authors



Jongjung Woo, he received the B.S. degree from the Department of Electronics of Kyungpook National University in 1982, and the M.S. and Ph.D. degrees from the Department of Electrical & Computer Engineering of University of Texas at Austin, in 1990 and 1993, respectively. He has worked as a professor in the School of Information Technology at Sungshin W. University since 1993. His current research interests include embedded software, mobile computing, computer architecture, and e-learning



Sugoog Shon, (Corresponding author), he received his B.S. (1982) degree in Electrical Engineering from Seoul National University, his M.S. (1984) degree in Electrical Engineering from Seoul National University, and his Ph.D. (1996) degree in Electrical and Computer Engineering from the University of Texas at Austin. He is a professor in the Department of Information and Telecommunication at the University of Suwon in Korea. His research interests include computer and embedded system, robot, network protocol, network simulation, and network programming.